

Figure D-1 Backroom Installation - Wayne Management Control System.


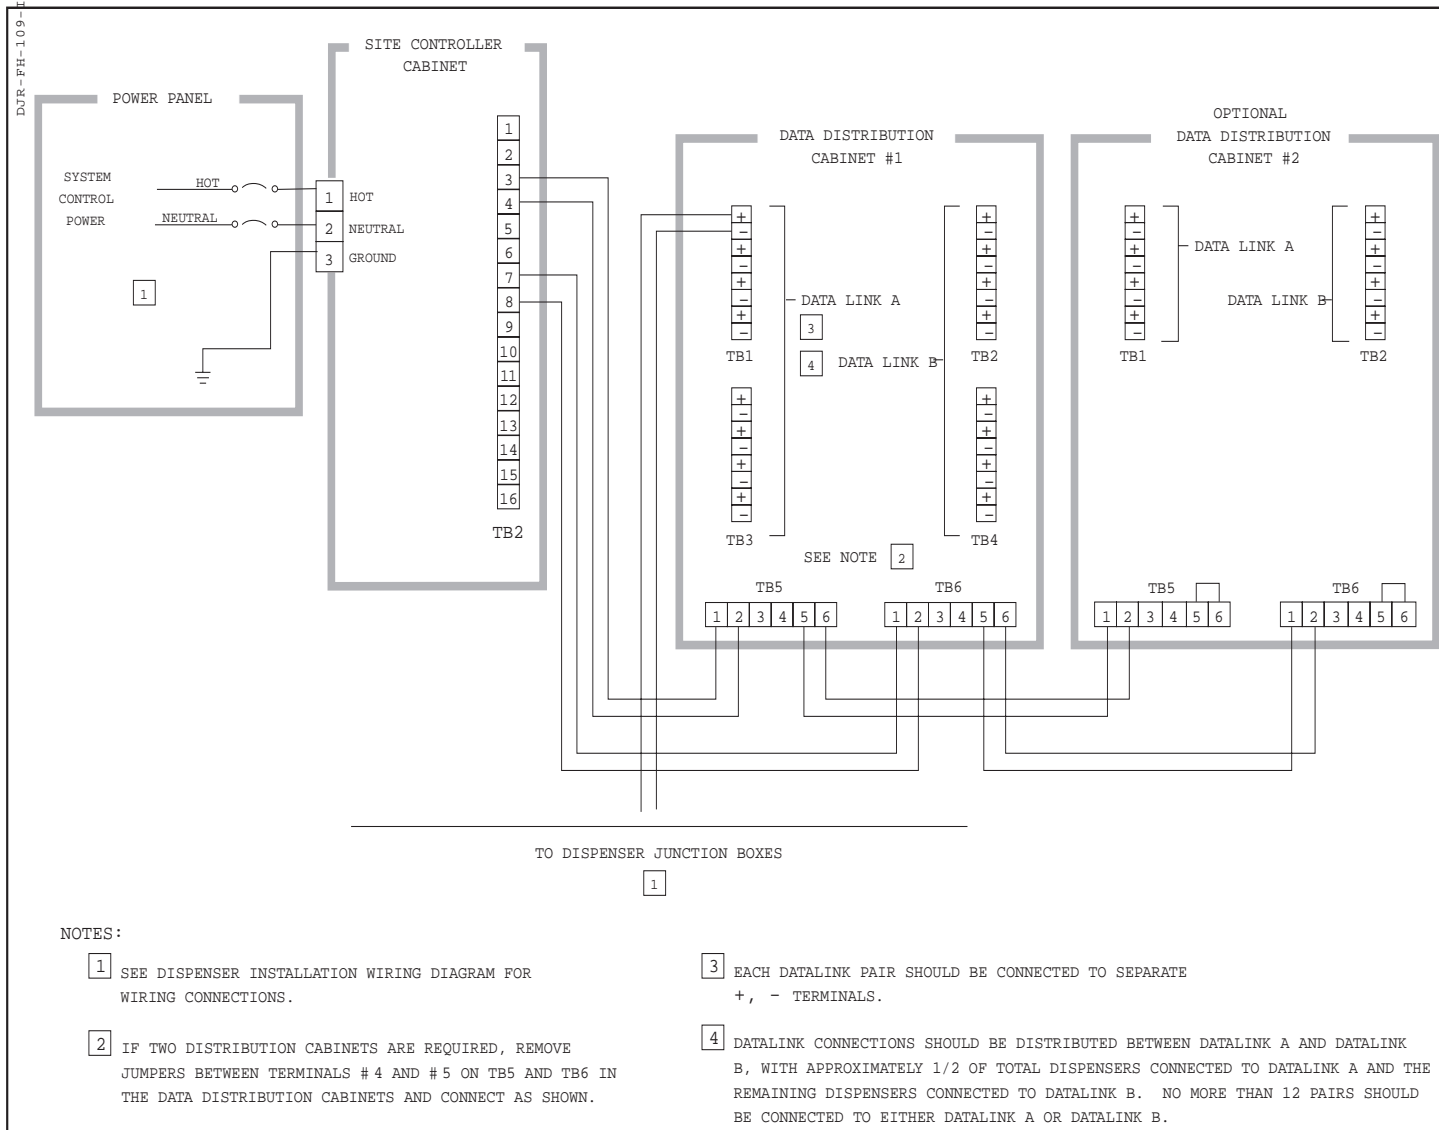


Figure D-2 Interconnection Wiring Diagram - Data Distribution Cabinet To Dispensers.

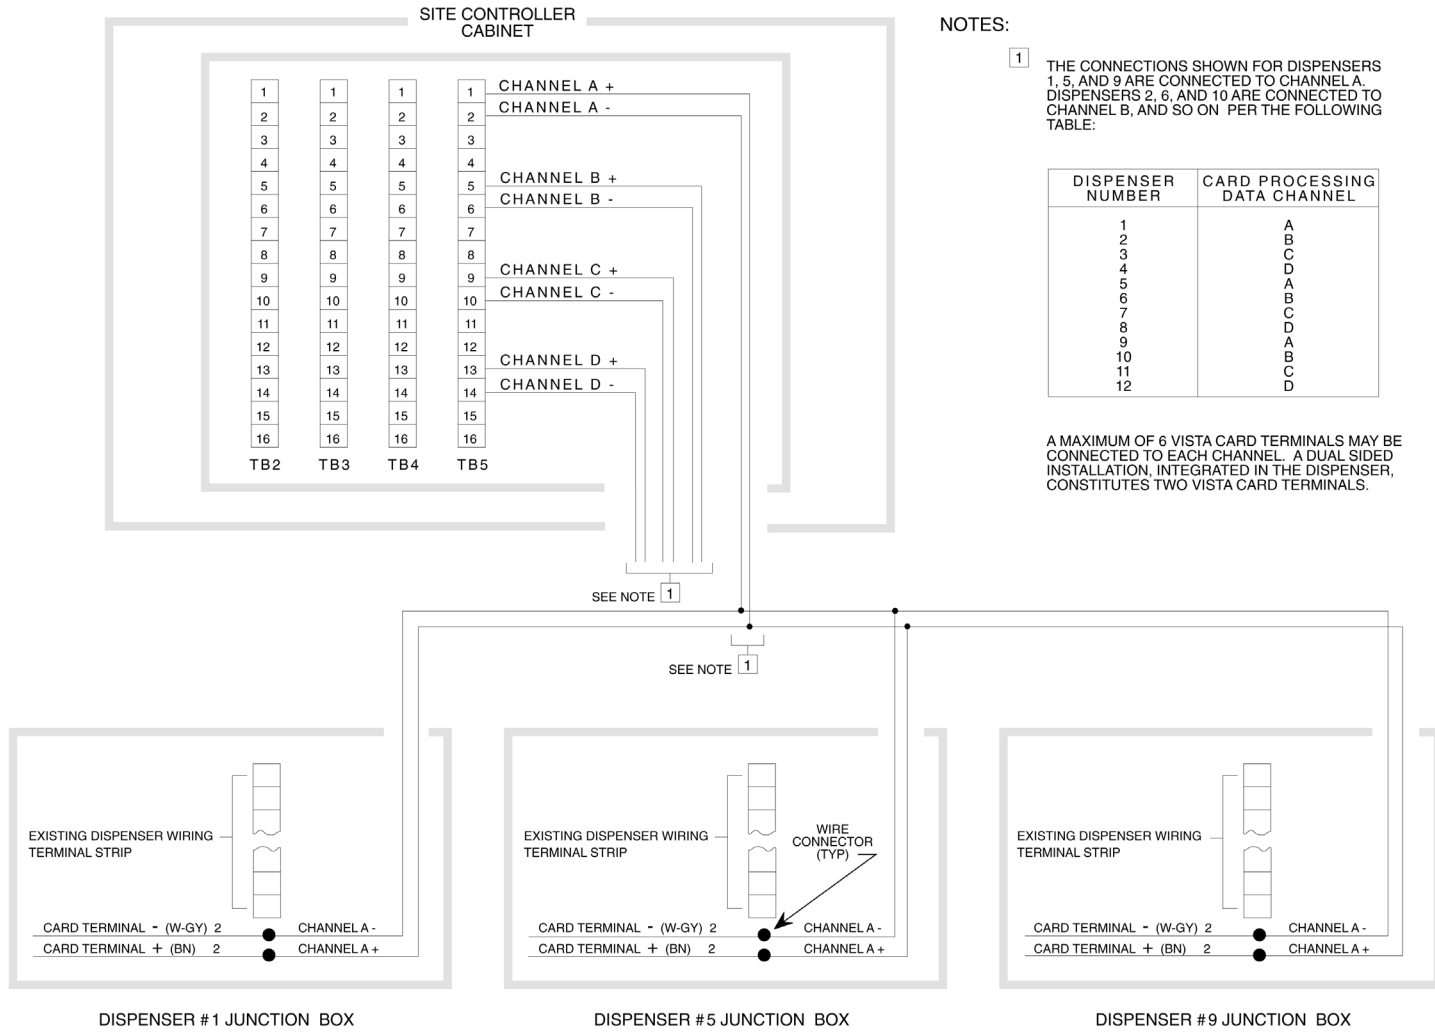

Note: Ethernet cable required for VGA option is shown on detailed Installation Wiring Diagram in Appx C.

Figure D-4 Interconnection Wiring Diagram - Dispenser Card Processing (CATs) .